


120V OUTLET BOX POWER FROM MAIN PANEL

PLUG IN GFI ADAPTER PART# TW-PA-GFI  
This kit converts an existing non-GFCI-protected duplex receptacle to a GFCI-protected receptacle.

THERMOCUBE DUAL OUTLET PART# TW-TC-35  
The Thermocube is a device which, when plugged into a standard 120V AC electrical outlet, will automatically turn power on and off to any device plugged into it. The Thermocube will automatically turn on power when air temperature reaches approximately 35°F (2°C) and will turn off the power when the temperature exceeds approximately 45°F (7°C).

FOR RESIDENTIAL AND COMMERCIAL/INDUSTRIAL  
PRE-TERMINATION HEATING CABLE  
STOCK LENGTHS: 6FT, 12FT, 18FT, 24FT,  
50FT, 75FT, 100FT, 125FT & 150FT.  
NOTE: Supply voltage: Choose between 120 or  
240 volts AC5W/ft (16W/m) at 50°F  
(10°C) 8W/ft (26W/m) at 32°F (0°C)  
Maximum exposure temperature of 150°F (65°C)  
Moisture-resistant, flame-resistant  
hermoplastic elastomer outer jacket  
16 AWG bus wires Pre-terminated 30in. (76cm)  
power cord with standard 3-prong  
(NEMA 5-15) plug  
\*240 volt doesn't include a plug!

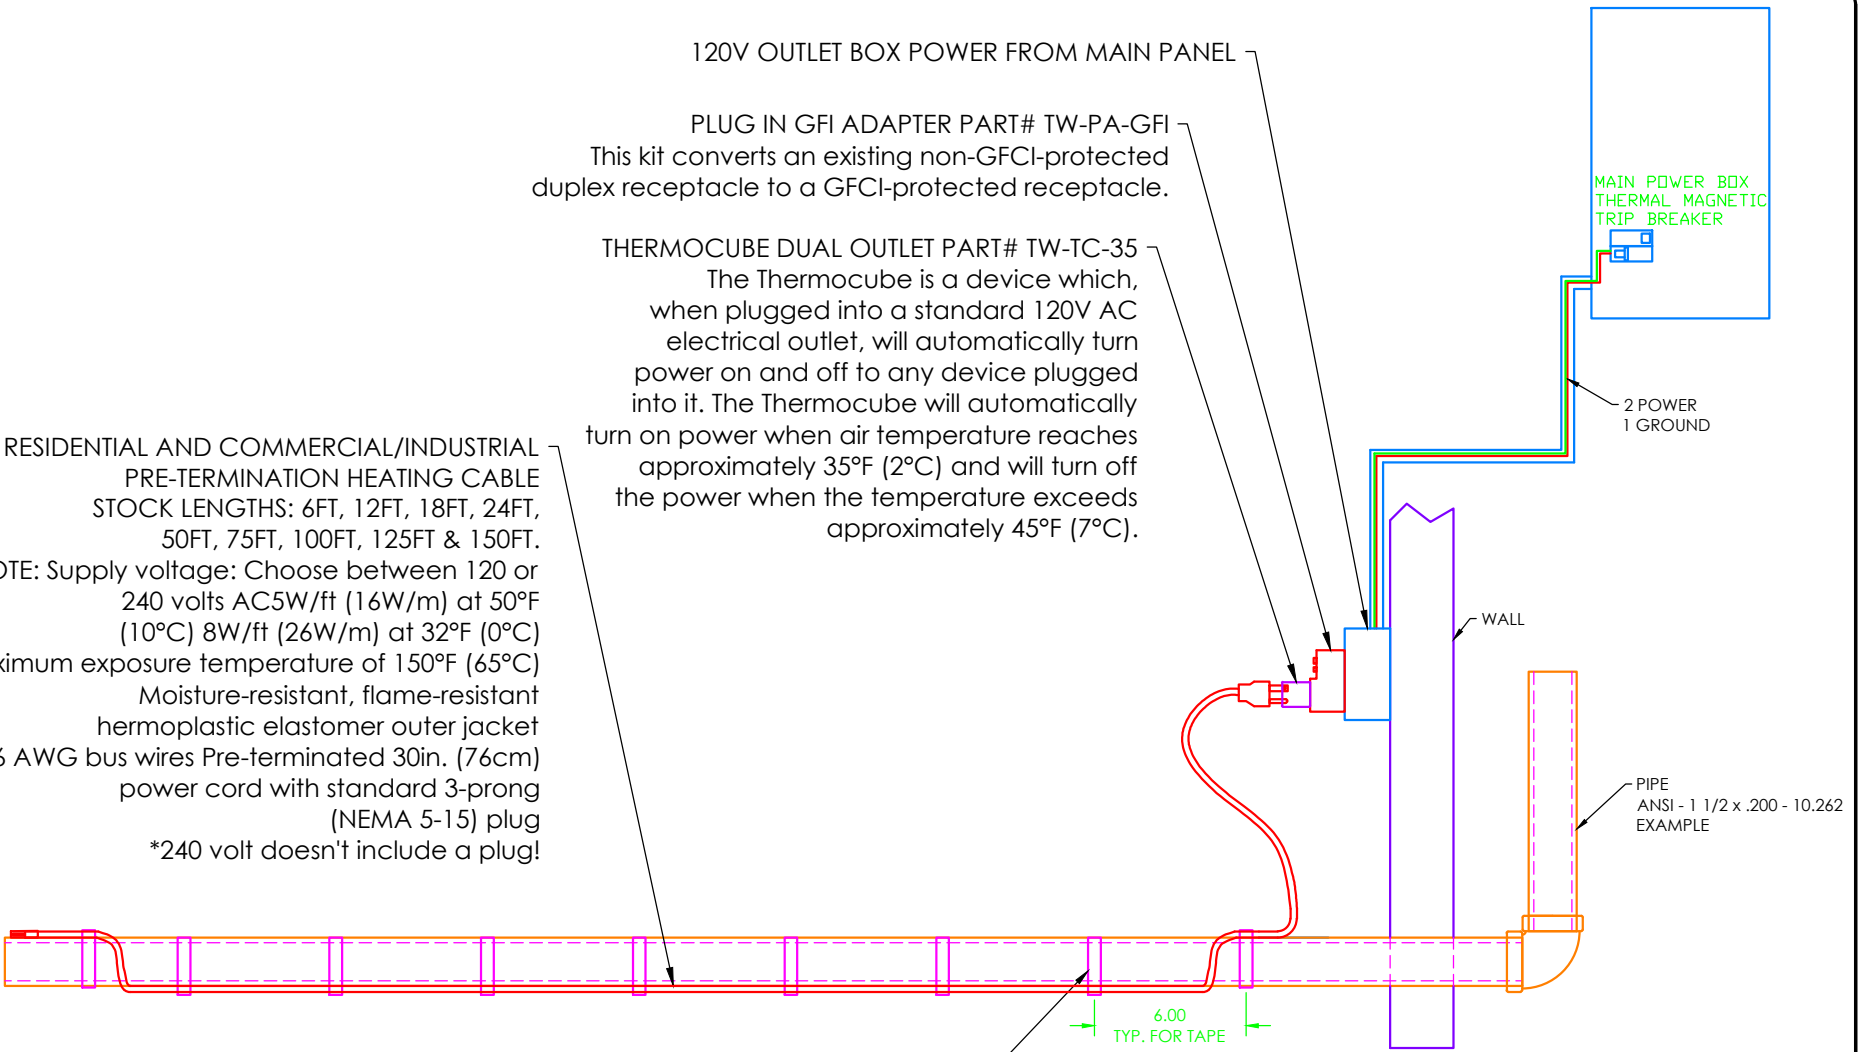

FIBERGLASS TAPE RAPPED AROUND BACK  
TO ITSELF EVERY 6" THE INTIRE LENGTH OF THE  
HEATING CABLE. PART# P212

**NOTES:**

THIS IS TO SHOW HOW TO LAYOUT YOUR PRE-TERMINATION SYSTEM  
WITH 30mA GFI PROTECTION. INSULATION SUPPLIED BY OTHER.

THIS DOCUMENT IS THE PROPERTY OF PROTHERM INDUSTRIES, AND ALL INFORMATION CONTAINED IN OR DISCLOSED BY THIS DOCUMENT IS THE PROPERTY OF PROTHERM INDUSTRIES NEITHER RECEIPT NOR POSSESSION OF THIS DOCUMENT CONVERTS OR TRANSFERS ANY RIGHT IN, OR LICENSES THE USE OF THE SUBJECT MATTERS OF THIS DOCUMENT, OR ANY DESIGN OR TECHNICAL INFORMATION SHOWN THEREON. THIS DOCUMENT IS TO MAINTAINED AS CONFIDENTIAL BY THE RECIPIENT AND SHALL NOT BE COPIED OR DUPLICATED IN ANY MANNER WITHOUT EXPRESS WRITTEN CONSENT. PROTHERM INDUSTRIES P.O. BOX 8448 HERMITAGE, TN 37078

REVISIONS				Office Phone: (615) 834-4044				
NO	DATE	BY		FAX: (615) 834-5834				
1			<b>PRE-TERMINATED CABLE INSTALLATION INSTRUCTIONS</b>					
2								
3								
4			DRAWN BY	J.COLE	SCALE	NTS	COMPUTER	N/A
5			CHECKED	S.BARNEY	DATE	12/7/17	DRAWING NUMBER	
6			REVAMPED	J.COLE	APPROVED	S.BARNEY	DRAWING NUMBER	PRE-TERM_JLC